

DUPLEX SOFTENER

MODEL NO. MT29/17S7-120

CAPACITY:

MIN. 96,000 grs. @ 10 lbs./cu.ft.
 MAX. 120,000 grs. @ 15 lbs./cu.ft.

FLOW RATE:

NORMAL 40 gpm.
 PEAK 57 gpm.
 BACKWASH 7 gpm.

TANK SIZE: 16" x 65"


COMPOSITE

MEDIA:

RESIN 4 cu.ft. (each tank)
 GRAVEL 75 lbs. (each tank)

PIPE SIZE:

INLET 2"
 OUTLET 2"
 DRAIN 1"
 BRINE 1/2"
 METER 2"

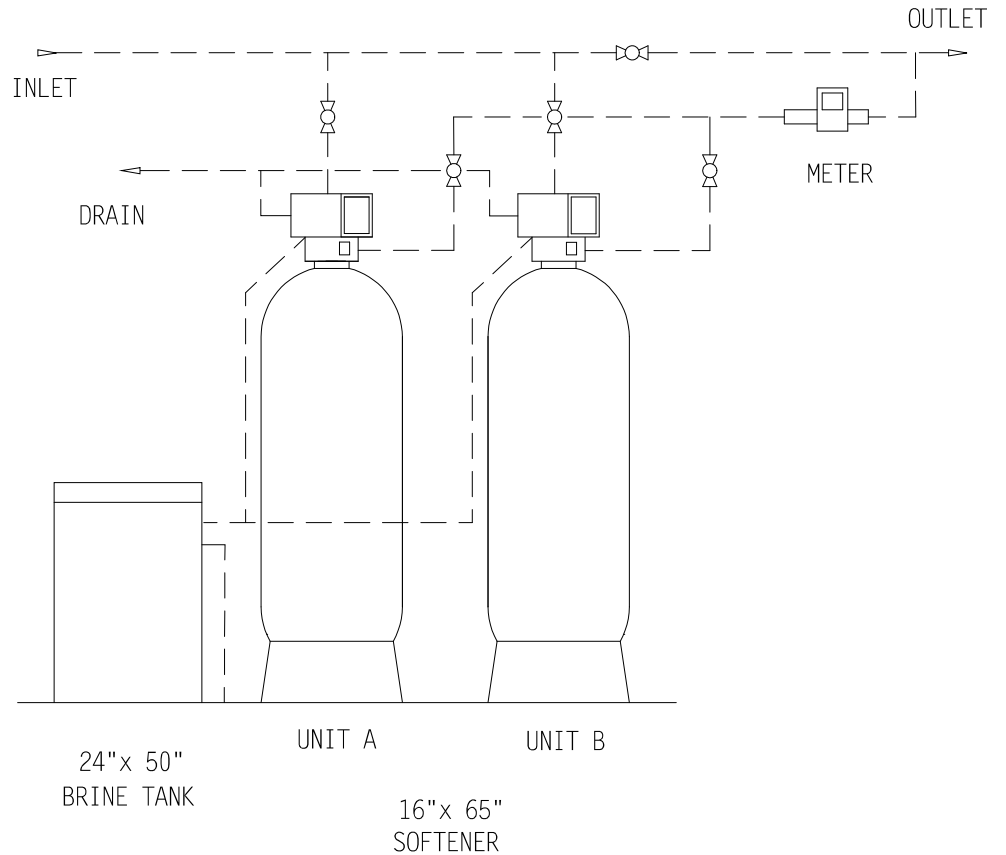

BRINE TANK

MODEL NO. BT2450R-454HF-5

TANK SIZE: 24"x 50"

POLYETHYLENE

CAPACITY:

100 gals.
 900 lbs./salt

BRINE VALVE: 454HF

BRINE WELL: 5"

WEIGHT (APPROX)

TOTAL SHIPPING 830 lbs.
 TOTAL OPERATING 2195 lbs.

NOTE:

ALL DASHED PIPE, VALVES,
 AND FITTINGS NOT PROVIDED
 BY NELSEN CORPORATION.

SPACE REQUIRED (APPROX)


64"L x 24"W x 78"H

PEAK FLOWS ARE NOT

RECOMMENDED FOR EXTENDED
 PERIODS OF TIME.

DO NOT SCALE DRAWING

THIS DRAWING IS ISSUED IN CONFIDENCE AND CANNOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN OR REFERRED TO WITHOUT DIRECT WRITTEN PERMISSION FROM NELSEN CORPORATION.

	<p>NELSEN CORPORATION</p> <p>3250 BARBER RD. NORTON, OH 44203 1-800-362-9686</p> <p>5701 W. LATHAM ST. #107 PHOENIX, ARIZONA 85043 1-866-445-4299</p>								
<p>GENERAL ARRANGEMENT DWG.</p> <p>SOFTENER 120K</p> <p>SYSTEM 7-ALTERNATING</p>									
<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="font-size: small;">DRAWN BY:</td> <td style="font-size: small;">RANDY A. MINOR II</td> </tr> <tr> <td style="font-size: small;">DATE:</td> <td style="font-size: small;">06-05-06</td> </tr> <tr> <td style="font-size: small;">CHECKED BY:</td> <td style="font-size: small;">R.GARRETT</td> </tr> <tr> <td style="font-size: small;">PAGE 1 OF 1</td> <td style="font-size: small;">REV:</td> </tr> </table>	DRAWN BY:	RANDY A. MINOR II	DATE:	06-05-06	CHECKED BY:	R.GARRETT	PAGE 1 OF 1	REV:	<p style="font-size: small;">DWG. NO.</p> <p style="font-size: large; font-weight: bold;">MT29/17S7-120</p>
DRAWN BY:	RANDY A. MINOR II								
DATE:	06-05-06								
CHECKED BY:	R.GARRETT								
PAGE 1 OF 1	REV:								